


SAP ABAP table /BEV3/CHPARAMS {Parameters for Exception Handling}

_BEV3_CHPARAMS
<u>MANDT</u> [CLNT (3)]
<u>VVORGE</u> [NUMC (4)]
<u>VERTNR</u> [NUMC (13)]
<u>PROTSATZ</u> [NUMC (4)]
<u>PARAM_ID</u> [CHAR (30)]

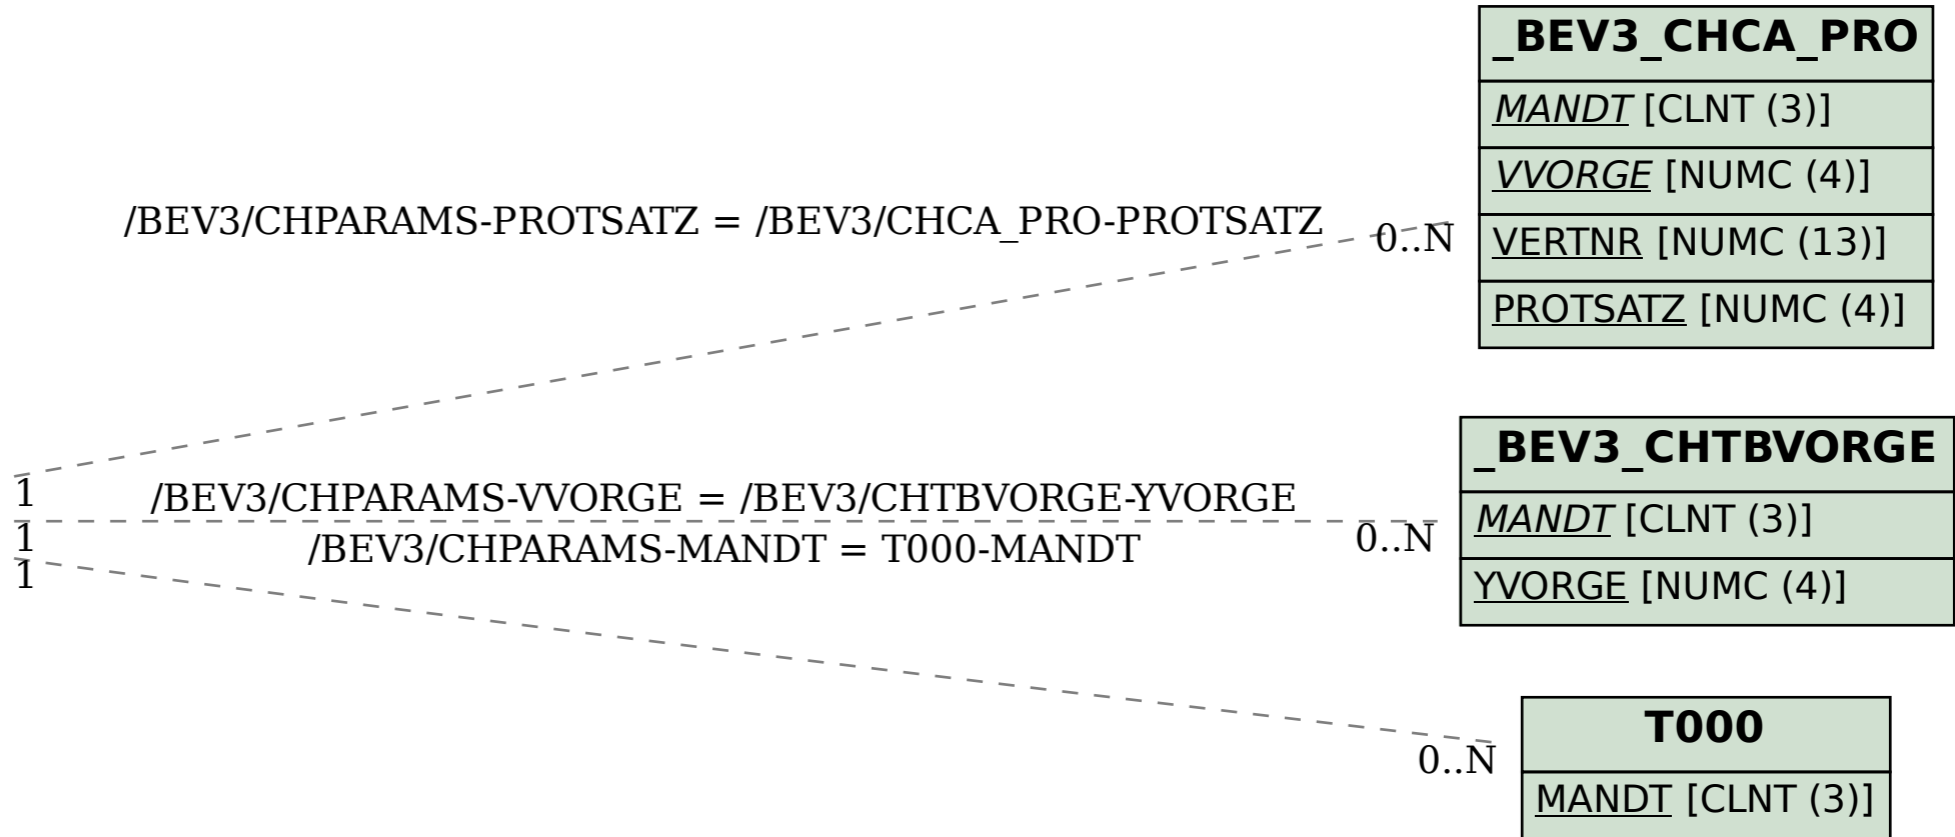

_BEV3_CHCA_PRO
<u>MANDT</u> [CLNT (3)]
<u>VVORGE</u> [NUMC (4)]
<u>VERTNR</u> [NUMC (13)]
<u>PROTSATZ</u> [NUMC (4)]

_BEV3_CHTBVORGE
<u>MANDT</u> [CLNT (3)]
<u>YVORGE</u> [NUMC (4)]

T000
<u>MANDT</u> [CLNT (3)]