


SAP ABAP table ROII_DIP_PARAM {Structure for Tank Dip parameters}

ROII_DIP_PARAM
<i>MANDT</i> [CLNT (3)]
<i>PAR_NAME</i> [CHAR (10)]
<i>UNIT_CHAR</i> [UNIT (3)]

OIB07
<u>MANDT</u> [CLNT (3)]
<u>PAR_NAME</u> [CHAR (10)]

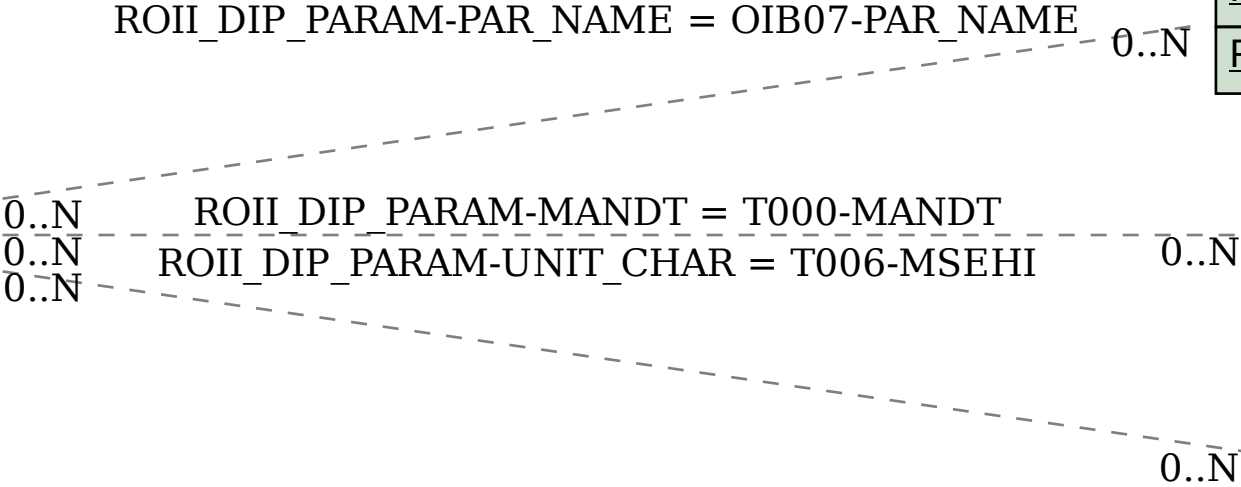

T000
<u>MANDT</u> [CLNT (3)]

T006
<u>MANDT</u> [CLNT (3)]
<u>MSEHI</u> [UNIT (3)]