


SAP ABAP table TE409 {Parameters for Independent Validations}

TE409
<u>MANDT</u> [CLNT (3)]
<u>PRUEFKL</u> [CHAR (4)]
<u>BENUTZSTD</u> [CHAR (10)]
<u>MAXLOPER</u> [CHAR (10)]
<u>MINLOPER</u> [CHAR (10)]

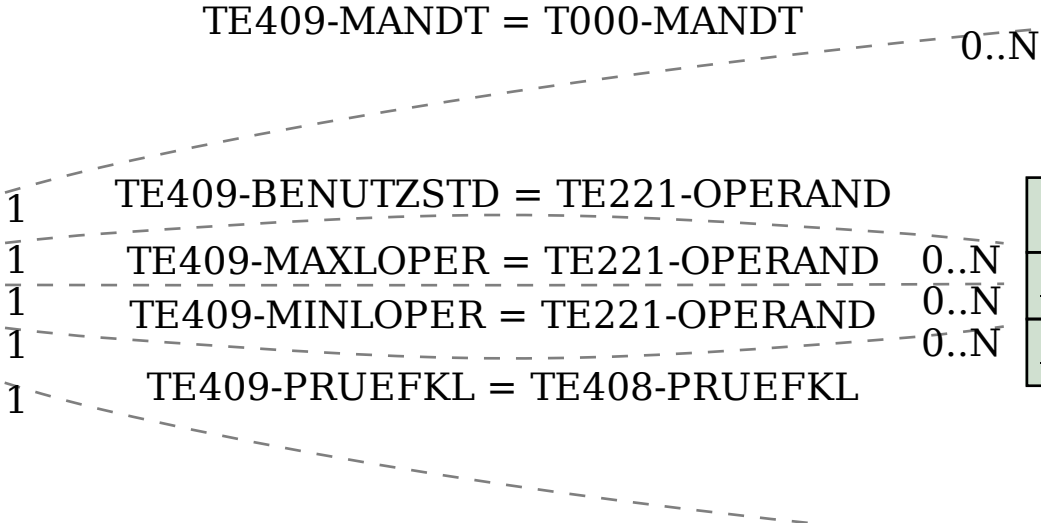

T000
<u>MANDT</u> [CLNT (3)]

TE221
<u>MANDT</u> [CLNT (3)]
<u>OPERAND</u> [CHAR (10)]

TE408
<u>MANDT</u> [CLNT (3)]
<u>PRUEFKL</u> [CHAR (4)]