


SAP ABAP table TIVRELS {LUM: Allgemeine Einstellungen}

TIVRELS
<u>MANDT</u> [CLNT (3)]
<u>VVXLEERKEY</u> [CHAR (1)]
<i>BIOBJAREATYPEDEF</i> [NUMC (4)]
<i>BIROLETYPDEF</i> [CHAR (4)]
<i>RECN_GRST_KOART</i> [NUMC (4)]

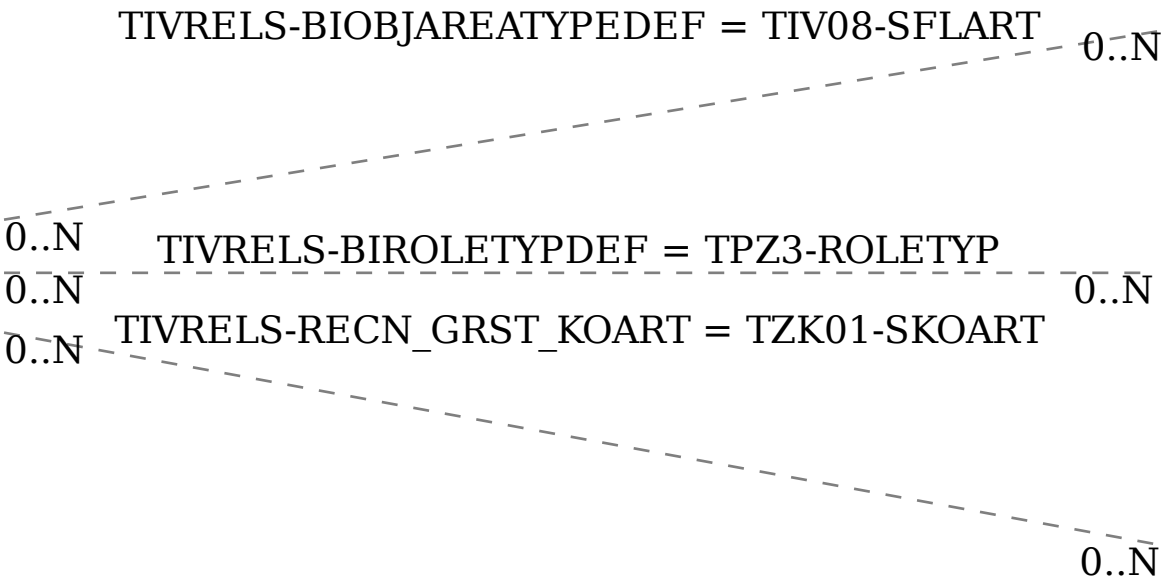

TIV08
<u>MANDT</u> [CLNT (3)]
<u>SFLART</u> [NUMC (4)]

TPZ3
<u>MANDT</u> [CLNT (3)]
<u>ROLETYP</u> [CHAR (4)]

TZK01
<u>MANDT</u> [CLNT (3)]
<u>RANTYP</u> [CHAR (1)]
<u>SKOART</u> [NUMC (4)]