


SAP ABAP table V_TCY07 {Generated Table for View}

V_TCY07
<u>MANDT</u> [CLNT (3)]
<u>SETPROF_ID</u> [CHAR (10)]
<u>ARBPL_SET</u> [CHAR (24)]
<u>AUFTR_SET</u> [CHAR (24)]
<u>KAPAR_SET</u> [CHAR (24)]
<u>ANFNG_SET</u> [CHAR (24)]
<u>AVAICAPVER</u> [NUMC (2)]

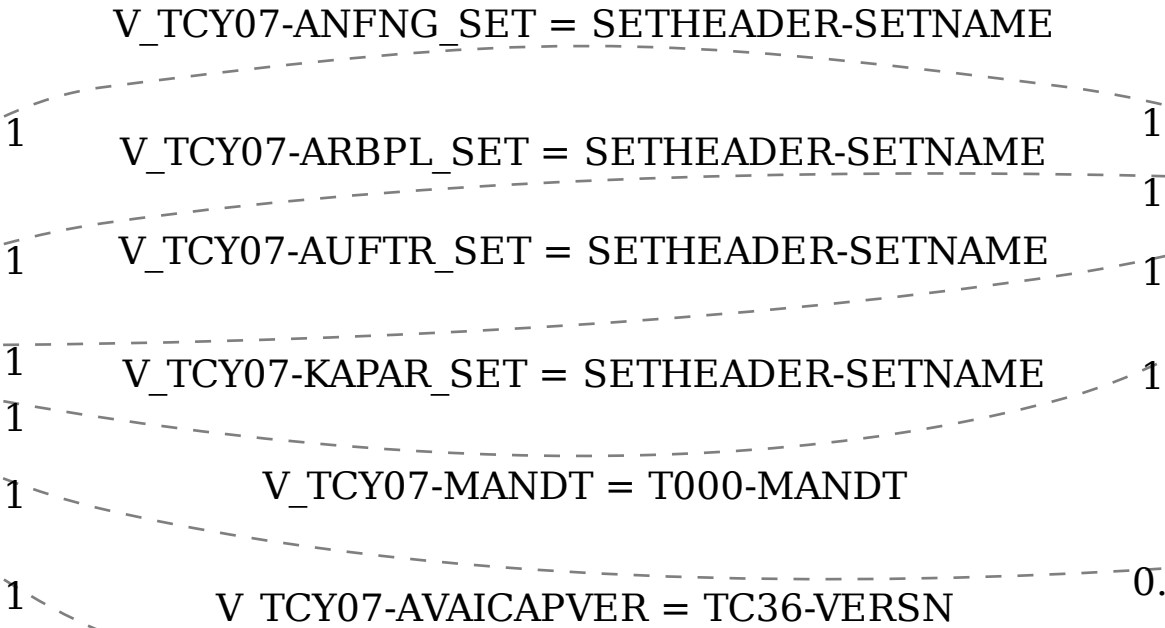

SETHEADER
<u>MANDT</u> [CLNT (3)]
<u>SETCLASS</u> [CHAR (4)]
<u>SUBCLASS</u> [CHAR (12)]
<u>SETNAME</u> [CHAR (24)]

T000
<u>MANDT</u> [CLNT (3)]

TC36
<u>MANDT</u> [CLNT (3)]
<u>VERSN</u> [NUMC (2)]